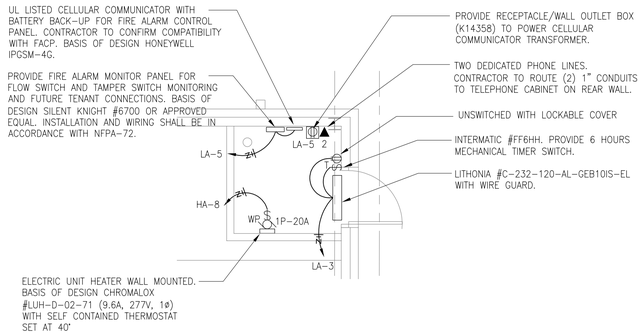

2 ENLARGED SPRINKLER RM.
SCALE: 1/4" = 1'-0"

(#) KEYED NOTES (#)

1. REFER TO SHEET EP1.0 FOR CONTINUATION OF CONDUIT AND MORE INFORMATION.
2. ROUTE LIGHTING BRANCH CIRCUIT THRU LIGHTING CONTACTOR IN LIGHTING CONTROL CABINET "LCC". SEE PANEL SCHEDULES AND DETAIL 1/E3.0 FOR MORE INFORMATION.
3. PROVIDE (1) 2" EMPTY CONDUIT WITH PULL WIRE FOR FUTURE ELECTRICAL SERVICE. ROUTE AT BAR JOIST LEVEL. CONTRACTOR TO COORDINATE TERMINATION OF CONDUIT WITH OWNER PRIOR TO INSTALLATION, AND TO CAP AND TAG EACH END.
4. PROVIDE (1) 2" EMPTY CONDUIT WITH PULL STRING FOR FUTURE TELEPHONE SERVICE. ROUTE AT BAR JOIST LEVEL. CONTRACTOR TO COORDINATE TERMINATION OF CONDUIT WITH OWNER PRIOR TO INSTALLATION, AND TO CAP AND TAG EACH END.
5. WEATHERPROOF RECEPTACLE MOUNTED ON BACK OF PARAPET. CONTRACTOR TO COORDINATE EXACT LOCATION WITH OWNER PRIOR TO INSTALLATION.
6. WEATHERPROOF JUNCTION BOX FOR IRRIGATION CONTROLLER. CONTRACTOR TO COORDINATE EXACT LOCATION AND OTHER REQUIREMENTS WITH LANDSCAPE CONTRACTOR PRIOR TO INSTALLATION.

GENERAL NOTES

1. PROVIDE PULL STRINGS IN ALL EMPTY CONDUITS.
2. ALL JUNCTION BOXES, CONDUITS, AND WIRES SHALL BE SIZED PER NEC.
3. PROVIDE A CONSTANT HOT FROM PANEL BOARD DIRECTLY TO ALL EMERGENCY BATTERY PACKS/BALLASTS IN EMERGENCY LIGHTING FIXTURES AND FIXTURES WITH SUBSCRIPT "-E".
4. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATION & MOUNTING HEIGHTS OF ALL LIGHTING FIXTURES SHOWN ON THIS DRAWING.
5. REFER TO SHEET E3.0 FOR SYMBOLS, SPECIFICATIONS AND ABBREVIATIONS.
6. ALL DEVICES AND EQUIPMENT OUTSIDE THE SCOPE OF WORK ARE EXISTING TO REMAIN U.O.N.
7. ELECTRICAL CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY PROBLEMS PERTAINING TO CIRCUIT AVAILABILITY, EXISTING CONDITIONS OR LOAD CAPACITY PRIOR TO COMMENCEMENT OF WORK.
8. EXTERIOR LIGHTING FIXTURES SHALL BE CONTROLLED VIA PHOTO CELL/TIME CLOCK AND AN OVERRIDE SWITCH AS SHOWN IN DETAIL 1/E3.0. ALL EXTERIOR LUMINAIRES AND ELECTRICAL DEVICES SHALL BE LISTED AS WEATHERPROOF TYPE.

A LICENSED FIRE ALARM PLANNING SUPERINDENDENT CERTIFIED TO A MINIMUM LEVEL 3, IN THE SUBFIELD OF FIRE ALARM SYSTEMS THROUGH THE NATIONAL INSTITUTE FOR CERTIFICATION IN ENGINEERING TECHNOLOGIES (NICET), SHALL PROVIDE PLANS AND CALCULATIONS FOR A MANUAL AND AUTOMATIC FIRE DETECTION AND ALARM SYSTEM TO COMPLY WITH THE BUILDING SPACE LAYOUT, BUILDING OCCUPANCY, NFPA 72, LOCAL AND STATE CODE REQUIREMENTS, AND THE FIRE ALARM AND DETECTION SYSTEM SPECIFICATIONS.

COORDINATE EXACT LOCATION OF ALL EQUIPMENT, WIREWAYS, PANELS, ETC. WITH OWNER/UTILITY COMPANIES PRIOR TO INSTALLATION.

CONTRACTOR TO PAINT ALL EXTERIOR GUTTERS, PANEL COVERS, CONDUIT, CABINETS, ETC. TO MATCH BACK OF BUILDING.

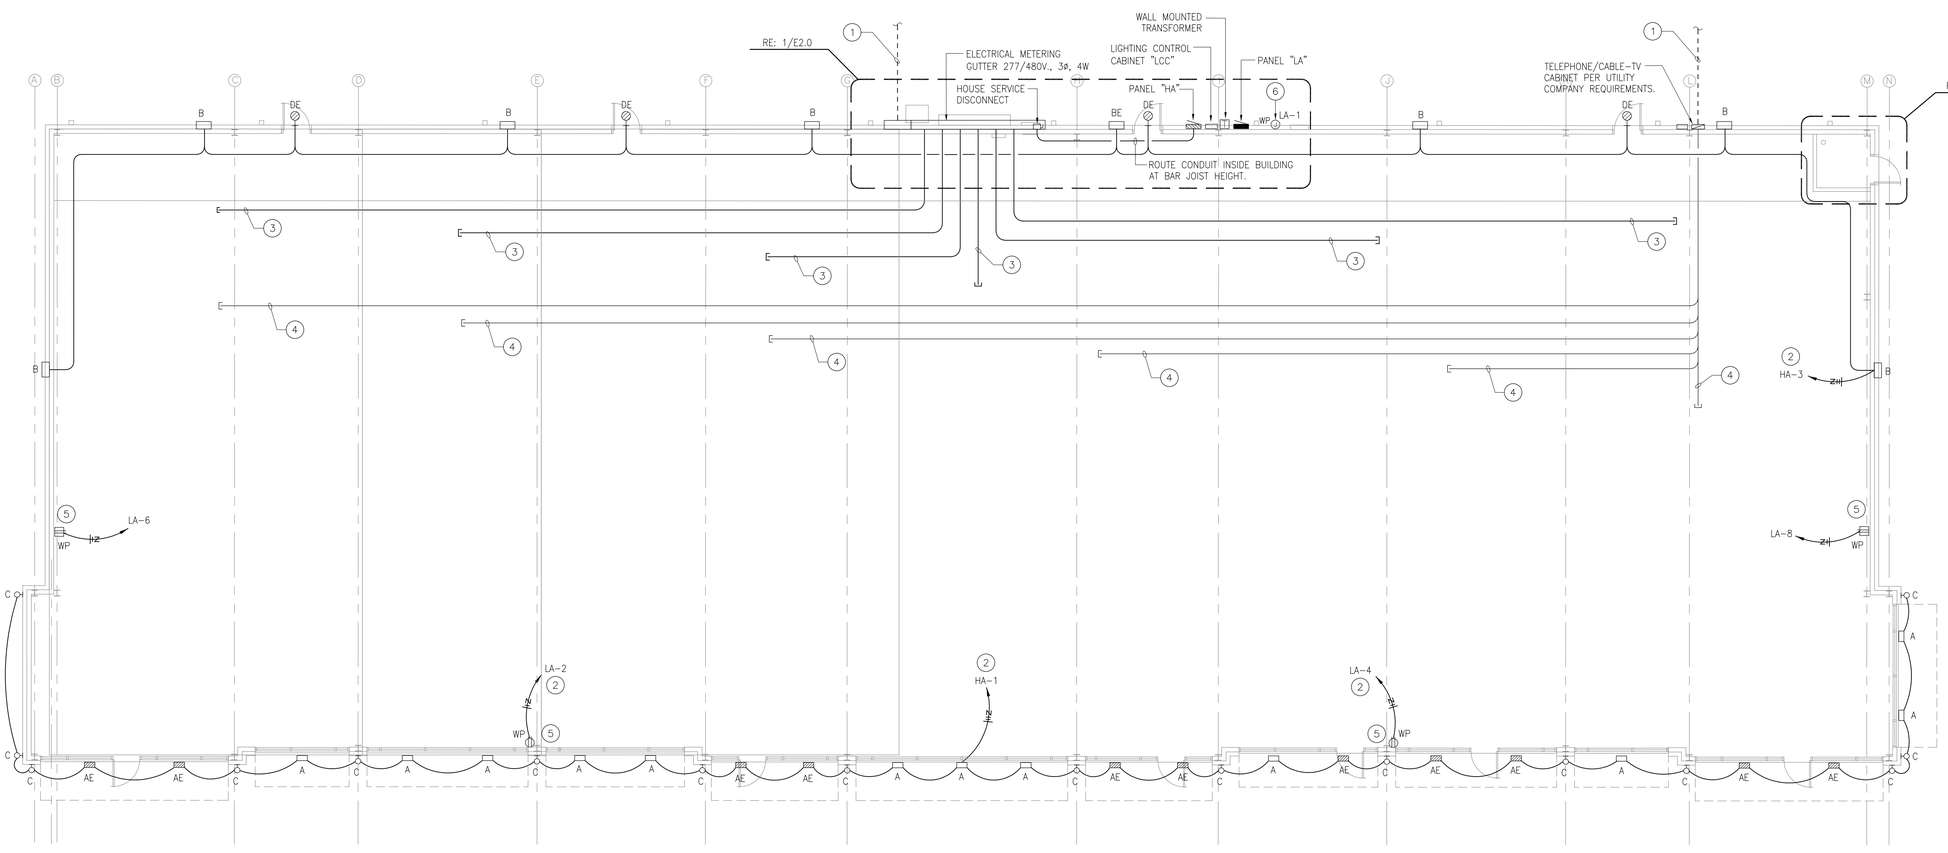

NORTH

1 ELECTRICAL FLOOR PLAN
SCALE: 1/8" = 1'-0"

JMF
Joseph M. Foster
& Associates
5406 Ariel St.
Houston,TX. 77096
Phone 713 432 1428
Cell 713 817 2972
Email
jmfassocs@comcast.net

BRADLEY KALMANS 80219 LICENSED PROFESSIONAL ENGINEER
06/05/19

SALAS O'BRIEN
expect a difference
10930 W. Sam Houston Parkway N., Suite 900
Houston, Texas 77064
281.664.1900 | Registration No. F-4111
Project No. 315-190083

ENGINEER SEAL & LOGO:

SEDONA
LAKES

STATE HWY. 249
TOMBALL, TEXAS 77377

PROJECT NAME & LOCATION:

ISSUED FOR	DATE
BID	-
PERMIT	-
CONSTRUCTION	-

REVISIONS

DATE	DESCRIPTION
06.05.19	FOR PERMIT

PROJECT NO.

SHEET TITLE
ELECTRICAL
FLOOR PLAN

SHEET NO.
E1.0

SHEET 3 OF 8